



Title: Sound Absorption Test Results

Product: 1" Envirocoustic Wood Wool Micro Strand with 2" CFAB Backer


Testing Standard: ASTM C423 (C-50 Mount)

About This Test: This test evaluates the effectiveness of a product to absorb sounds at multiple frequencies when directly installed on a ceiling or wall with 2" (50mm) acoustical backer.

Test Result Summary: NRC -0.95 ; SAA - 0.92

NRC	SAA
0.95	0.92

Frequency (Hz)	Absorption (Sabins / Unit)
100	0.14
125	0.22
160	0.27
200	0.47
250	0.78
315	0.88
400	1.09
500	1.09
630	1.04
800	1.01
1000	0.95
1250	0.94
1600	0.90
2000	0.96
2500	0.94
3150	0.85
4000	0.85
5000	0.80

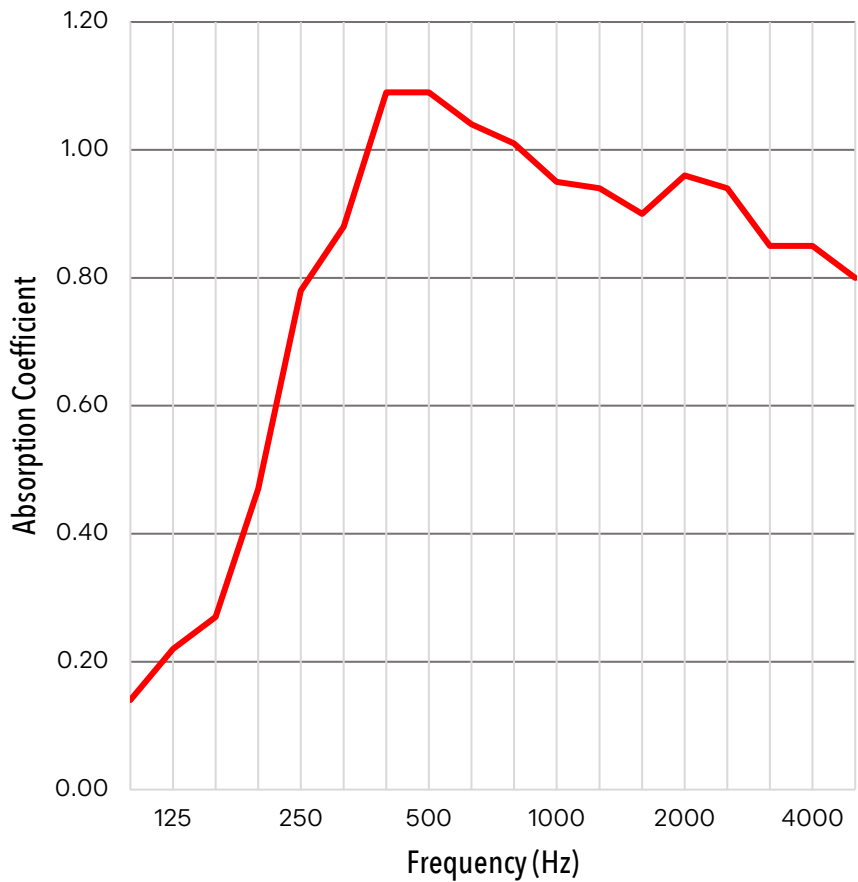

Test Date: 4/15/2021

Test ID: ESP035429P-22-R1

ASI TESTING DISCLAIMER

ASI makes every effort to ensure the accuracy and reliability of the information provided. Laboratory testing is conducted by independent testing organizations. ASI does not guarantee that field tests or independent tests will not vary.



Element Materials Technology
662 Cromwell Avenue
St Paul, MN
55114-1720 USA

P 651 645 3601
F 651 659 7348
T 888 786 7555
info.stpaul@element.com
element.com

**SOUND ABSORPTION TESTING CONDUCTED ON
1" CEMENTITIOUS WOOD FIBER ACOUSTIC PANEL WITH 2" CELLULOSE FIBER ACOUSTIC
BACKER**

ASI
123 Columbia Court, N.
Chaska, MN 55318

Date: April 23, 2021
Author: Mark Coopet
Report Number: ESP035429P-22 R1

Customer PO: 00081905



EAR Controlled Data: This document contains technical data whose export and re-export/retransfer is subject to control by the U.S. Department of Commerce under the Export Administration Act and the Export Administration Regulations. The Department of Commerce's prior written approval is required for the export or re-export/retransfer of such technical data to any foreign person, foreign entity or foreign organization whether in the United States or abroad.

These commodities, Technology, or software were exported from the United States in accordance with the Export Administration Regulations. Diversion contrary to U.S. law is prohibited.

This project shall be governed exclusively by the General Terms and Conditions of Sale and Performance of Testing Services by Element Materials Technology. In no event shall Element Materials Technology be liable for any consequential, special or indirect loss or any damages above the cost of the work.

Ear Controlled Data

This Page Alone is not a complete report

Noise Reduction Coefficient (ASTM C423-17)

INTRODUCTION:

This report presents the results of acoustical testing of 1" Cementitious Wood Fiber Acoustic Panels with 2" Cellulose Fiber Acoustic Backer. This testing was requested by Mr. Joe Satek and was completed on April 15, 2021.

This report must not be reproduced except in full without the approval of Element Materials Technology. The test results contained in this report pertain only to the specific assemblies tested and not necessarily to all similar constructions.

The results stated in this report represent only the specific construction and acoustical conditions present at the time of the test. Measurements performed in accordance with this standard on nominally identical constructions and acoustical conditions may produce different results.

TEST RESULTS SUMMARY:

<i>Noise Reduction Coefficient (NRC) Test</i>				Test Results		
Test #	Sample Identification	Weight (lbs)	Weight (psf)	NRC	SAA	--
22	C50 Mount – 1" Cementitious Wood Fiber Acoustic Panels with 2" Cellulose Fiber Acoustic Backer	185	2.57	0.95	0.92	--

Tabular and graphical presentations of the data are presented under "TEST RESULTS" below.

SPECIMEN DESCRIPTION: (Also see "Test Results")

Each of the Acoustic Panels were labeled for testing. 8 of the Wood Fiber Panels were 1" thick, measuring 24" x 48" and weighing 17.5 lbs. each. 2 of the Wood Fiber Panels were 1" thick, measuring 12" x 48" and weighing 8.5 lbs. each. Panels were placed butted together over the 50mm wood furring strips which were laid out with a 24" on-center spacing. Between the furring strips and beneath the 1" Wood Fiber Panels were 2" Cellulose Fiber Acoustic Backer panels cut-to fit. Total weight of the Cellulose Panels after fitting them between the furring strips was 28 lbs. Exposed perimeter edges were sealed with Duct Tape.

Note: The Cellulose Fiber Backer had a density of 3 lb.

Note: 1" Cementitious Wood Fiber panel used 0.5mm strand construction as noted per the customer.

TEST PROCEDURE AND EQUIPMENT:

Sound Absorption Test

ASTM C 423-17, “Sound Absorption and Sound Absorption Coefficient by the Reverberation Room Method”, was followed in every respect. The panels were tested in a Type C50 Mounting in accordance to ASTM E795-16.

NRC was calculated by rounding the sound absorption coefficients for 250, 500, 1000 and 2000 Hz to the nearest 0.05. SAA was calculated by rounding the sound absorption coefficients for the twelve frequencies from 200 Hz to 2500 Hz to the nearest 0.01.

The Noise Reduction Coefficient (NRC) is a scalar representation of the amount of sound energy absorbed upon striking a particular surface. An NRC of 0 indicates perfect reflection; an NRC of 1 indicates perfect absorption.

The Sound Absorption Average (SAA) is the average of the absorption coefficients for the twelve one-third octave bands from 200 to 2500 Hz.

The higher the SAA or NRC value, the better the material absorbs sound.

TEST EQUIPMENT:

Item Description	ID #	Manufacturer/Model	Serial #	Calibration Due
1/2" Pressure Condenser Microphone	PT-162-075	GRAS/40AD	19220-1244	7/17/2021
Microphone Calibrator	MM-440-003	Bruel & Kjaer/4230	282266	7/17/2021
Data Acquisition Module	PT-162-107	National Instruments/NI9234	1735986-1893EB3	6/8/2021
Temp and Humidity Transmitter	PT-162-077	Dwyer Instruments/Series RH	M90714-E4SV-Y	6/4/2021

TEST DATA:

SOUND ABSORPTION
ASTM C423

General Information


Project No:	ESP035429P-22
Customer:	ASI
Test Date:	04-15-2021
Specimen ID:	1 Inch Cementitious Wood fiber Acoustic Panel
Specimen Description:	C50 Mount 1" - 24" - 48"
Specimen Dimensions - Area:	96.00" W x 108.00" H - 72.00 ft ²
Operator:	MJC

Data Table

	absorption empty (m ²)	absorption * sample (m ²)	Absorption Coefficient
80	3.75	1.04	0.16
100	5.28	0.92	0.14
125	4.02	1.48	0.22
160	3.47	1.84	0.27
200	3.97	3.17	0.47
250	4.10	5.23	0.78
315	3.94	5.88	0.88
400	3.96	7.29	1.09
500	4.45	7.29	1.09
630	4.64	6.95	1.04
800	5.04	6.75	1.01
1000	5.32	6.32	0.95
1250	5.72	6.29	0.94
1600	6.52	6.00	0.90
2000	7.32	6.44	0.96
2500	8.18	6.26	0.94
3150	9.57	5.70	0.85
4000	11.69	5.69	0.85
5000	14.52	5.35	0.80

Room Conditions


Temperature	21.4 °C
R.H.	44 %
ATM	987 hPa

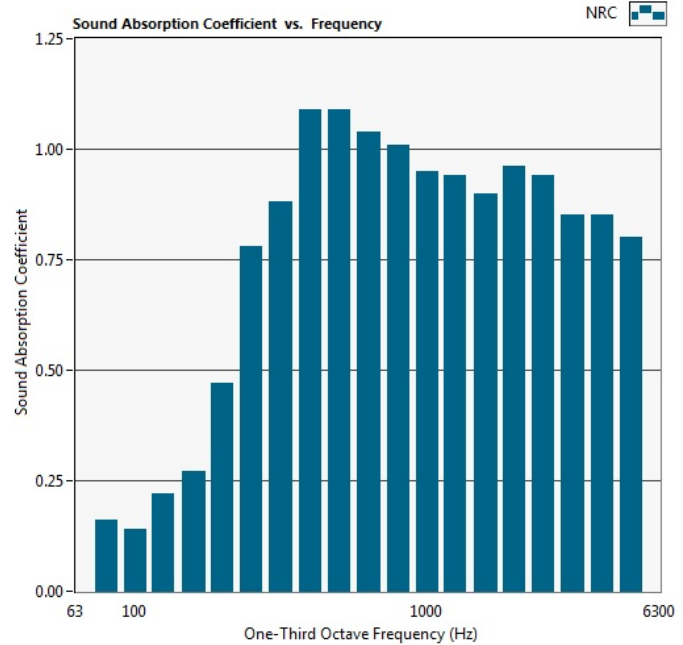

NRC
0.95

SAA
0.92

* based on an extended plane area of 72.00 ft²



Mark Coopet
Technician, Product Validation
Building Materials and Acoustics
651-645-3601



1" Cementitious Wood Fiber Acoustic Panel (C50 Layout)