



Title: Thermal Resistance (R-Value) Test Results

Product: 2" Envirocoustic Wood Wool

Application: Ceiling or Wall

Testing Standard: ASTM C518-21

Test Date: 05/19/2022

Why this test: This test determines the thermal resistance, commonly known as the R-Value, of the product. The product is placed between two plates, one cold and one hot, which measure the heat flow to determine the thermal conductivity (k-Value) and thermal resistance (R-Value). This is repeated for 3 samples of the product, the average being the reported R-Value. The values determined by this test satisfy R-Value regulations for insulation materials (i.e. US Federal Trade Commission's "R-Value Rule" (10 CFR 460).

Test Result Summary: R-Value 3.74

Test Specimen ID	Sample Name	Avg. Heat Flux (Btu/hr·ft ²)	Avg. Thermal Conductance (C) (Btu/hr·ft ² ·°F)	Avg. Thermal Resistance (R) (hr·ft ² ·°F/Btu)	Avg. Thermal Resistivity (r) (hr·ft ² ·°F/Btu-in)	Apparent Thermal Conductivity (k) (Btu-in/hr·ft ² ·°F)	Specimen Avg. Thickness (inches)	*Specimen Avg. Density (Lbs/Ft ³)
1	Sample 1	13.07	0.261	3.83	1.95	0.513	1.963	24.35
2	Sample 2	13.20	0.264	3.79	1.92	0.521	1.976	24.28
3	Sample 3	13.90	0.278	3.60	1.82	0.548	1.974	25.95

Test ID: N6823.01-116-25

ASI TEST RESULT DISCLAIMER

ASI makes every effort to ensure the accuracy and reliability of the information provided. Laboratory testing is conducted by independent testing organizations. ASI does not guarantee that field tests or independent tests will not vary.

©2022 ASI

ASI HEAT FLOW METER TEST REPORT

SCOPE OF WORK

CEMENTITIOUS WOOD FIBER ACOUSTIC PANEL - 2" THICK - ASTM C518

REPORT NUMBER

N6823.01-116-25 R0

TEST DATE

05/18/2022 to 05/19/2022

ISSUE DATE

05/23/22


PAGES

9

DOCUMENT CONTROL NUMBER

RT-R-AMER-Test-7906 (01/17/22)

©2017 INTERTEK

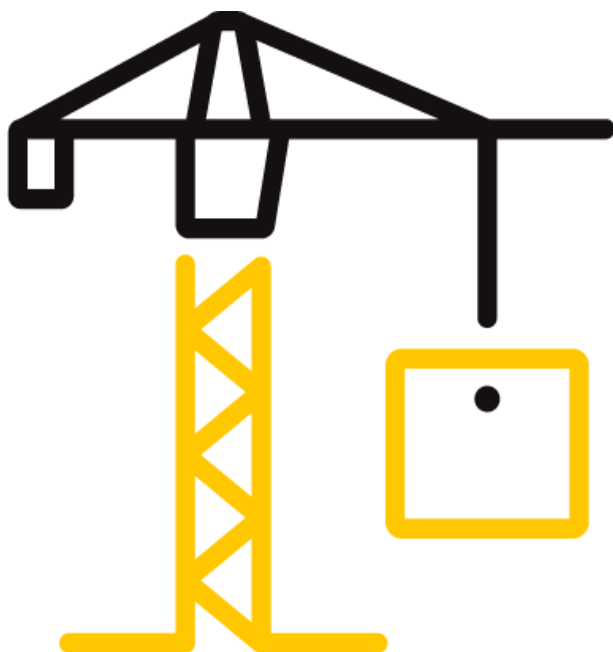

TEST REPORT FOR ASI

Report No.: N6823.01-116-25 R0

Date: 05/23/22

REPORT ISSUED TO

ASI

123 Columbia Court North
Chaska, Minnesota 55318

SECTION 1

SUMMARY

SERIES/MODEL: Cementitious Wood Fiber Acoustic Panel - 2" Thick

Architectural Testing, Inc. (an Intertek Company), dba Intertek Building & Construction (B&C), was contracted by ASI to perform heat flow meter testing in accordance with ASTM C518-21 on their, Acoustic Panel. Results obtained are tested values and were secured by using the designated test method. Testing was conducted at the Intertek B&C test facility in York, Pennsylvania.

Intertek B&C is an accredited testing laboratory and all testing was conducted in full compliance with ASTM approved procedures and specifications.

Intertek B&C will service this report for the entire test record retention period. The test record retention period ends four years after the test date. Test records, such as detailed drawings, datasheets, or other pertinent project documentation, will be retained for the entire test record retention period. This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

For INTERTEK B&C:

COMPLETED BY: Benjamin W. Green

TITLE: Project Lead

SIGNATURE:


Digitally Signed by: Benjamin W. Green

DATE: 05/23/22

BWG:bwg

REVIEWED BY: Eric S. Leitner

TITLE: Manager - Thermal Testing

SIGNATURE:


Digitally Signed by: Eric S. Leitner

DATE: 05/23/22

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

TEST REPORT FOR ASI

Report No.: N6823.01-116-25 R0

Date: 05/23/22

SECTION 2

TEST METHODS

The product were evaluated in accordance with the following:

ASTM C518-21, *Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus*

SECTION 3

TEST SPECIMEN DESCRIPTION

SERIES/MODEL	Cementitious Wood Fiber Acoustic Panel - 2" Thick
PRODUCT TYPE	Acoustic Panel
SPECIMEN TEST SIZE	12" x 12"

**This product is not a compressible sample.*

SPECIMEN CONSTRUCTION	The test specimens were provided by the client as three panels measuring approximately 2" x 12" x 12". The panels were tested as provided. See Appendix B: Photographs.
------------------------------	---

SECTION 4

TEST CONDITIONS

COLD PLATE TEMPERATURE	50°F nominal
WARM PLATE TEMPERATURE	100°F nominal
MEAN SPECIMEN TEMPERATURE	75°F nominal
AVERAGE TEMPERATURE GRADIENT	50°F/inch nominal
HEAT FLOW ORIENTATION	Vertical Heat Flow, The specimen was prepared and installed into the test apparatus horizontally so that the measured heat flow was from the hot plate to the cold plate, as intended for use.
SPECIMEN CONFIGURATION	Single horizontal specimen
METERING AREA	4" x 4" heat flux transducer on warm side plate

TEST REPORT FOR ASI

Report No.: N6823.01-116-25 R0

Date: 05/23/22

SECTION 5 EQUIPMENT

DESCRIPTION	SERIAL #	ASSET #	CALIBRATION DATE
Dial Calipers (0-12")	52-008-012-0	INT01848	01/18/23
Adams Scale (CBK 70A)	17960300	65197	12/15/22
Digital Indicators (0-1")	17960305	65196	01/14/23
Temp/Humidity Transmitter	12961265	63736	02/24/23
LC2 - LaserComp Fox304	13091619-F304	65203	*

*Device calibrated prior to use.

SECTION 6 CALIBRATION INFORMATION

Calibration Material	NIST Standard Reference Material 1450d, 1" Thickness Fibrous Glass Board, Serial Number 357, dated January 20, 2012, no expiration.	
Material Thermal Conductance	0.228	(C) (Btu/hr-ft ² ·°F)

SECTION 7 TEST RESULTS (IP Units)

Test Specimen ID	Sample Name	Avg. Heat Flux (Btu/hr-ft ²)	Avg. Thermal Conductance (C) (Btu/hr-ft ² ·°F)	Avg. Thermal Resistance (R) (hr-ft ² ·°F/Btu)	Avg. Thermal Resistivity (r) (hr-ft ² ·°F/Btu-in)	Apparent Thermal Conductivity (k) (Btu-in/hr-ft ² ·°F)	Specimen Avg. Thickness (inches)	†Specimen Avg. Density (Lbs/Ft ³)
1	Sample 1	13.07	0.261	3.83	1.95	0.513	1.963	24.35
2	Sample 2	13.20	0.264	3.79	1.92	0.521	1.976	24.28
3	Sample 3	13.90	0.278	3.60	1.82	0.548	1.974	25.95

TEST REPORT FOR ASI

Report No.: N6823.01-116-25 R0

Date: 05/23/22

SECTION 7 (continued)

TEST RESULTS (SI Units)

Test Specimen ID	Sample Name	Avg. Heat Flux (W/m ²)	Avg. Thermal Conductance (C) (W/m ² ·K)	Avg. Thermal Resistance (Rsi) (m ² ·K/W)	Avg. Thermal Resistivity (r) (m·K/W)	Apparent Thermal Conductivity (k) (W/m·K)	Specimen Avg. Thickness (mm)	†Specimen Avg. Density (kg/m ³)
1	Sample 1	41.24	1.483	0.67	13.52	0.074	49.86	390.11
2	Sample 2	41.63	1.497	0.67	13.31	0.075	50.19	388.91
3	Sample 3	43.86	1.577	0.63	12.64	0.079	50.14	415.71

†The density of the sample was determined by dividing the average weight of the sample by its volume. The weight was measured using a calibrated scale and the volume was determined by measuring the length, width, and height of the sample.

ANSI/NCSL Z540-2-1997 Type B uncertainty for this test was: 4%

TEST REPORT FOR ASI

Report No.: N6823.01-116-25 R0

Date: 05/23/22

SECTION 8

PICTURES

Cementitious Wood Fiber Acoustic Panel - 2" Thick, (Sample 1)



TEST REPORT FOR ASI

Report No.: N6823.01-116-25 R0

Date: 05/23/22

SECTION 8 (continued)

PICTURES

Cementitious Wood Fiber Acoustic Panel - 2" Thick, (Sample 2)



TEST REPORT FOR ASI


Report No.: N6823.01-116-25 R0

Date: 05/23/22

SECTION 8 (continued)

PICTURES

Cementitious Wood Fiber Acoustic Panel - 2" Thick, (Sample 3)

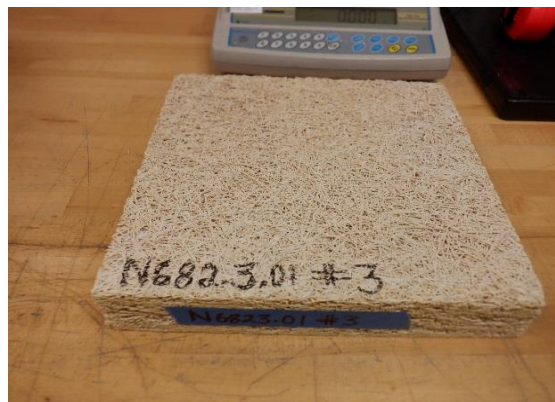

TEST REPORT FOR ASI

Report No.: N6823.01-116-25 R0

Date: 05/23/22

SECTION 9

REVISION LOG

REVISION #	DATE	PAGES	REVISION
.01 R0	05/23/22	N/A	Original Report Issued to Customer.